


**COMPRESSOR DATA SHEET**

**Federal Uniform Test Method for Certain Air Compressors Not Applicable**

**Rotary Compressor: Variable Frequency Drive**

**MODEL DATA - FOR COMPRESSED AIR**

1	Manufacturer: Atlas Copco		
2	Model Number: GA 315 VSD+-10.4	Date:	03-10-2022
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled	Type:	Screw
	<input checked="" type="checkbox"/> Lubricated <input type="checkbox"/> Oil-free	# of Stages:	1
3	Full Load Operating Pressure*(b)	150.0	psig*(b)
4	Drive Motor Nominal Rating	214.6 & 214.6	hp
5	Drive Motor Nominal Efficiency	96.3 & 96.3	percent
6	Fan Motor Nominal Rating (if applicable)	4.0 & 4.0 & 4.0	hp
7	Fan Motor Nominal Efficiency	83.0 & 83.0 & 83.0	percent
8*	Input Power (kW)	Capacity (acfm) *(a,d)	Specific Power (kW/100 acfm)*(d)
	380.5      Max	1,920.6	19.8
	303.2	1,538.7	19.7
	230.9	1,156.7	20.0
	161.7	774.8	20.9
9*	94.9      Min	392.8	24.2
9*	Total Package Input Power at Zero Flow*(c,d)	0.1	kW

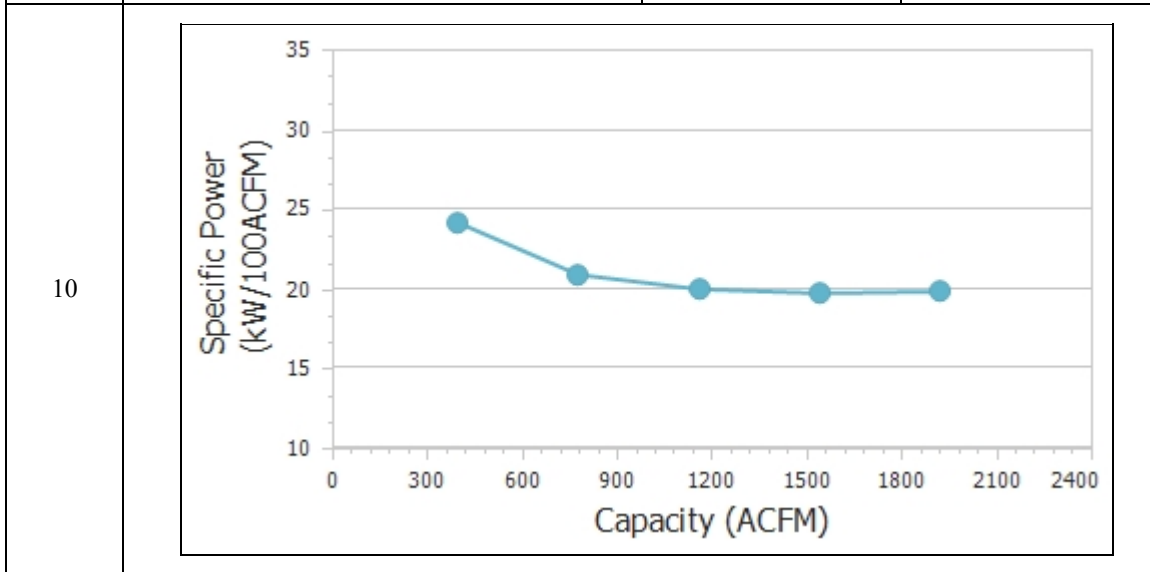

\*For models that are tested in the CAGI Performance Verification Program, these items are verified by program administrator

Consult CAGI website for a list of participants in the third party verification program:

[www.cagi.org](http://www.cagi.org)

Notes:

- Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; acfm is actual cubic feet per minute at inlet conditions.
- The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.
- No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- Tolerance is specified in ISO 1217, Annex E, as shown in table below:  
NOTE: The terms "power" and "energy" are synonymous for purposes of this document.

Member



Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m <sup>3</sup> / min	ft <sup>3</sup> / min	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	+/- 10
0.5 to 1.5	15 to 50	+/- 6	+/- 7	
1.5 to 15	50 to 500	+/- 5	+/- 6	

ROT 031.2  
12/19 R3

Above 15	Above 500	+/- 4	+/- 5	
----------	-----------	-------	-------	--

This form was developed by the Compressed Air and Gas Institute for the use of its members. CAGI has not independently verified the reported data.