

In Accordance with Federal Uniform Test Method for Certain Lubricated Air Compressors

Rotary Compressor: Variable Frequency Drive

MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer: Atlas Copco		
2	Model Number: GA37LVSD+	Date: 11/30/2020	
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled	Type: Screw	
		# of Stages: 1	
3	Full Load Operating Pressure ^b	102	psig ^b
4	Drive Motor Nominal Rating	50	hp
5	Drive Motor Nominal Efficiency	96	percent
6	Fan Motor Nominal Rating (if applicable)	1.1	hp
7	Fan Motor Nominal Efficiency	73	percent
8*	Input Power (kW)	Capacity (acfm) ^{a,d}	Specific Power (kW/100 acfm) ^d
	45.0 Max	279.5	16.1
	34.9	215.4	16.2
	29.3	178.4	16.4
	20.9	120.9	17.3
	15.7	84.7	18.5
	11.4 Min	54.7	20.8
9*	Total Package Input Power at Zero Flow ^{c, d}		1.1 kW
10	Isentropic Efficiency		81.27 %
11	<p>Note: Graph is only a visual representation of the data in Section 8 Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35 X-Axis Scale, 0 to 25% over maximum capacity</p>		

*For models that are tested in the CAGI Performance Verification Program, these items are verified by the third party administrator.

Consult CAGI website for a list of participants in the third party verification program:

www.cagi.org

NOTES:

- Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; ACFM is actual cubic feet per minute at inlet conditions.
- The operating pressure at which the Capacity (Item 8) and Electrical Consumption (Item 8) were measured for this data sheet.
- No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- Tolerance is specified in ISO 1217, Annex E, as shown in table below:

NOTE: The terms "power" and "energy" are synonymous for purposes of this document.

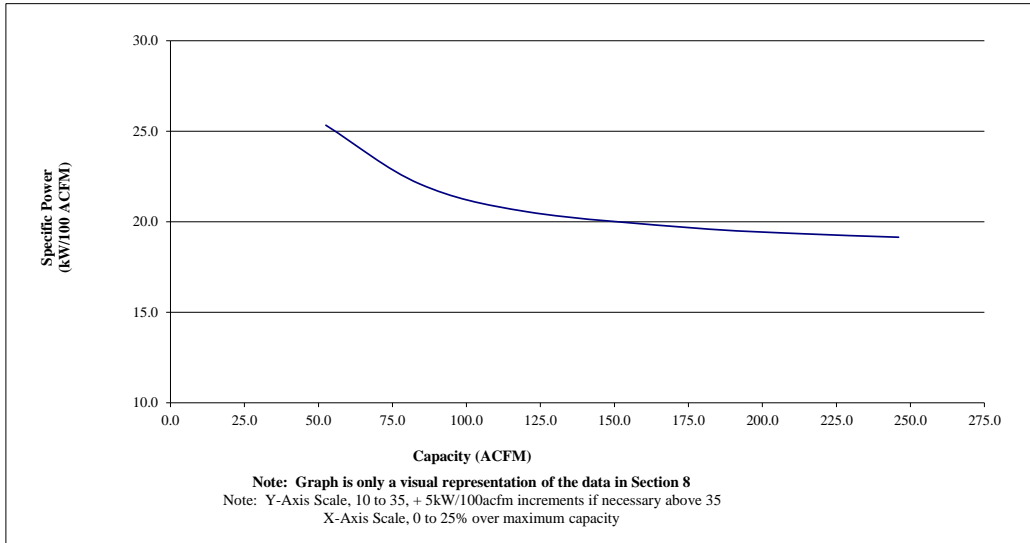
Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m ³ / min	ft ³ / min	%	%	
Below 0.5	Below 17.6	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	17.6 to 53	+/- 6	+/- 7	
1.5 to 15	53 to 529.7	+/- 5	+/- 6	
Above 15	Above 529.7	+/- 4	+/- 5	



ROT 030.1

In Accordance with Federal Uniform Test Method for Certain Lubricated Air Compressors

Rotary Compressor: Variable Frequency Drive

MODEL DATA - FOR COMPRESSED AIR			
1	Manufacturer: Atlas Copco		
2	Model Number: GA37LVSD+	Date: 11/30/2020	
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled	Type: Screw	
		# of Stages: 1	
3	Full Load Operating Pressure ^b	138	psig ^b
4	Drive Motor Nominal Rating	50	hp
5	Drive Motor Nominal Efficiency	96	percent
6	Fan Motor Nominal Rating (if applicable)	1.1	hp
7	Fan Motor Nominal Efficiency	73	percent
8*	Input Power (kW)	Capacity (acfm) ^{a,d}	Specific Power (kW/100 acfm) ^d
	47.1 Max	246.0	19.1
	41.0	211.9	19.3
	34.7	176.5	19.7
	24.8	120.7	20.5
	18.6	84.2	22.1
	13.3 Min	52.5	25.3
9*	Total Package Input Power at Zero Flow ^{c, d}	1.1	kW
10	Isentropic Efficiency	79.43	%
11	 <p>Note: Graph is only a visual representation of the data in Section 8 Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35 X-Axis Scale, 0 to 25% over maximum capacity</p>		

*For models that are tested in the CAGI Performance Verification Program, these items are verified by the third party administrator.

Consult CAGI website for a list of participants in the third party verification program:

www.cagi.org

NOTES:

- Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; ACFM is actual cubic feet per minute at inlet conditions.
- The operating pressure at which the Capacity (Item 8) and Electrical Consumption (Item 8) were measured for this data sheet.
- No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- Tolerance is specified in ISO 1217, Annex E, as shown in table below:

NOTE: The terms "power" and "energy" are synonymous for purposes of this document.

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m ³ / min	ft ³ / min	%	%	
Below 0.5	Below 17.6	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	17.6 to 53	+/- 6	+/- 7	
1.5 to 15	53 to 529.7	+/- 5	+/- 6	
Above 15	Above 529.7	+/- 4	+/- 5	



ROT 030.1

In Accordance with Federal Uniform Test Method for Certain Lubricated Air Compressors

Rotary Compressor: Variable Frequency Drive

MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer: Atlas Copco		
2	Model Number: GA37LVSD+	Date: 11/30/2020	
	<input checked="" type="checkbox"/> Air-cooled <input type="checkbox"/> Water-cooled	Type: Screw	
		# of Stages: 1	
3	Full Load Operating Pressure ^b	181	psig ^b
4	Drive Motor Nominal Rating	50	hp
5	Drive Motor Nominal Efficiency	96	percent
6	Fan Motor Nominal Rating (if applicable)	1.1	hp
7	Fan Motor Nominal Efficiency	73	percent
8*	Input Power (kW)	Capacity (acfm) ^{a,d}	Specific Power (kW/100 acfm) ^d
	48.2 Max	209.2	23.0
	41.3	173.6	23.8
	37.6	155.2	24.2
	30.1	118.1	25.5
	26.3	99.1	26.5
	22.6 Min	81.0	27.9
9*	Total Package Input Power at Zero Flow ^{c,d}	1.1	kW
10	Isentropic Efficiency	73.46	%
11	<p>Note: Graph is only a visual representation of the data in Section 8 Note: Y-Axis Scale, 10 to 35, + 5kW/100acfm increments if necessary above 35 X-Axis Scale, 0 to 25% over maximum capacity</p>		

*For models that are tested in the CAGI Performance Verification Program, these items are verified by the third party administrator.

Consult CAGI website for a list of participants in the third party verification program:

www.cagi.org

NOTES:

- Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; ACFM is actual cubic feet per minute at inlet conditions.
- The operating pressure at which the Capacity (Item 8) and Electrical Consumption (Item 8) were measured for this data sheet.
- No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.
- Tolerance is specified in ISO 1217, Annex E, as shown in table below:

NOTE: The terms "power" and "energy" are synonymous for purposes of this document.

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m ³ / min	ft ³ / min	%	%	
Below 0.5	Below 17.6	+/- 7	+/- 8	+/- 10%
0.5 to 1.5	17.6 to 53	+/- 6	+/- 7	
1.5 to 15	53 to 529.7	+/- 5	+/- 6	
Above 15	Above 529.7	+/- 4	+/- 5	



ROT 030.1