COMPRESSOR DATA SHEET

Federal Uniform Test Method for Certain Air Compressors Not Applicable

Rotary Compressor: Variable Frequency Drive

MODEL DATA - FOR COMPRESSED AIR

1	Manufacturer: Atlas Copco		
2	Model Number: ZT 30 FLX-8.6 VSD	Date:	03-18-2025
	☑ Air-cooled ☐ Water-cooled	Type:	Tooth
	☐ Lubricated ☑ Oil-free	# of Stages:	2
3	Full Load Operating Pressure*(b)	124.7	psig*(b)
4	Drive Motor Nominal Rating	40.2 & 40.2	hp
5	Drive Motor Nominal Efficiency	96.3 & 96.3	percent
6	Fan Motor Nominal Rating (if applicable)	1.3	hp
7	Fan Motor Nominal Efficiency	54.0	percent

	Input Power (kW)		Capacity (acfm) *(a,d)	Specific Power (kW/100 acfm)*(d)
8*	35.5	Max	155.5	22.8
	31.4		135.5	23.1
	26.6		115.4	23.1
	23.2		95.3	24.4
	19.5	Min	75.3	25.9
9*	Total Package Input Power at Zero Flow*(c,d)		0.0	kW

10

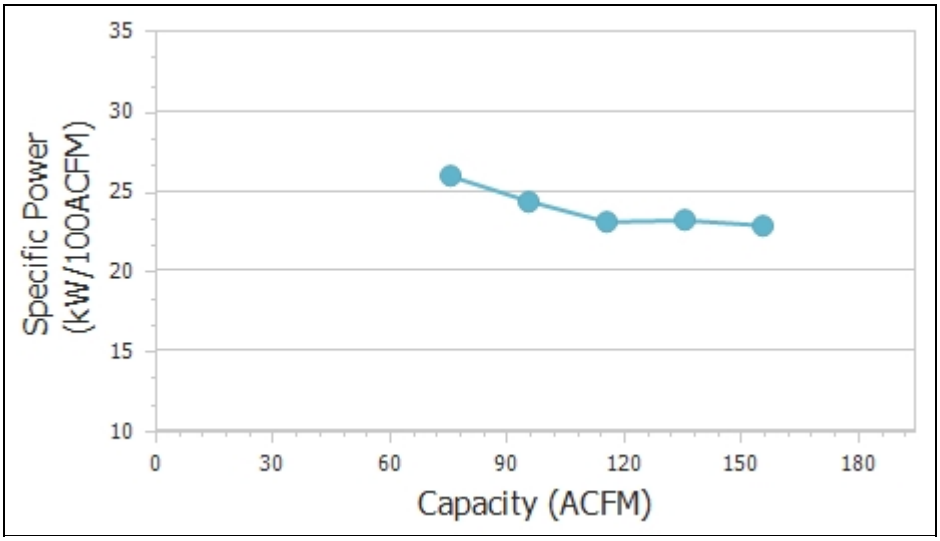

*For models that are tested in the CAGI Performance Verification Program, these items are verified by program administrator

Consult CAGI website for a list of participants in the third party verification program: www.cagi.org

Notes:

a. Measured at the discharge terminal point of the compressor package in accordance with ISO 1217, Annex E; acfm is actual cubic feet per minute at inlet conditions.

b. The operating pressure at which the Capacity and Electrical Consumption were measured for this data sheet.

c. No Load Power. In accordance with ISO 1217, Annex E, if measurement of no load power equals less than 1%, manufacturer may state "not significant" or "0" on the test report.

d. Tolerance is specified in ISO 1217, Annex E, as shown in table below:
NOTE: The terms "power" and "energy" are synonymous for purposes of this document.

Member

CAGI Compressed Air & Gas Institute

Volume Flow Rate at specified conditions		Volume Flow Rate	Specific Energy Consumption	No Load / Zero Flow Power
m3 / min	ft3 / min	%	%	
Below 0.5	Below 15	+/- 7	+/- 8	
0.5 to 1.5	15 to 50	+/- 6	+/- 7	+/- 10
1.5 to 15	50 to 500	+/- 5	+/- 6	
Above 15	Above 500	+/- 4	+/- 5	